



Étude photométrique (niveaux d'éclairage)




NIVEAU 0

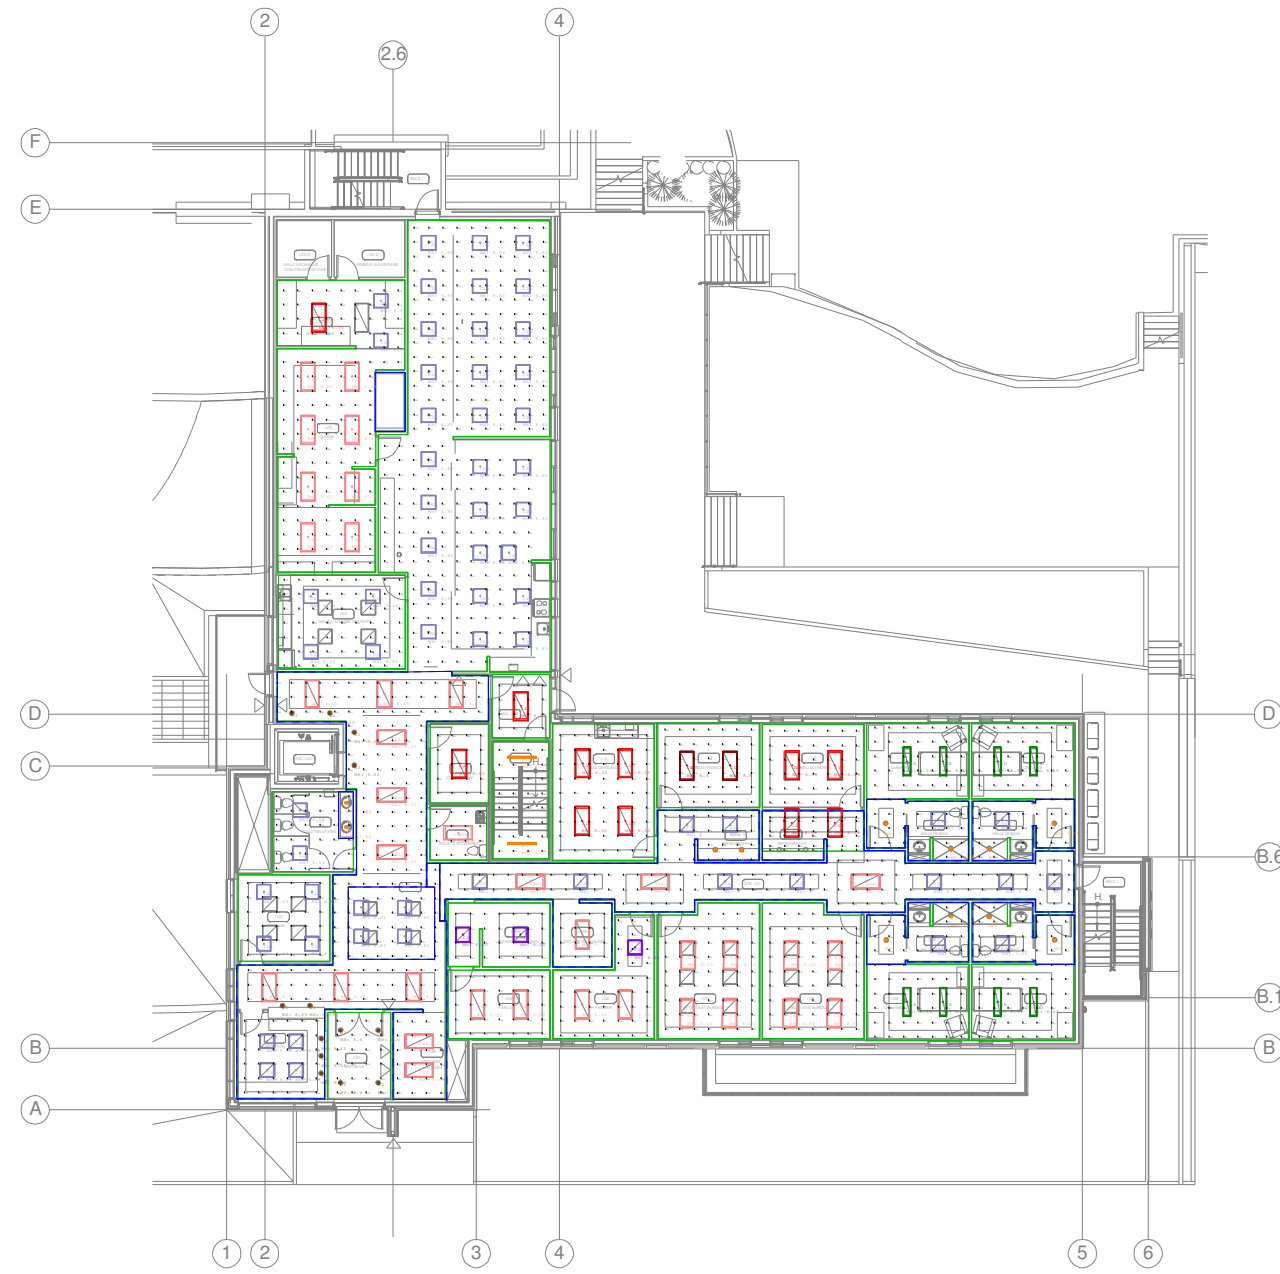

NIVEAU 1

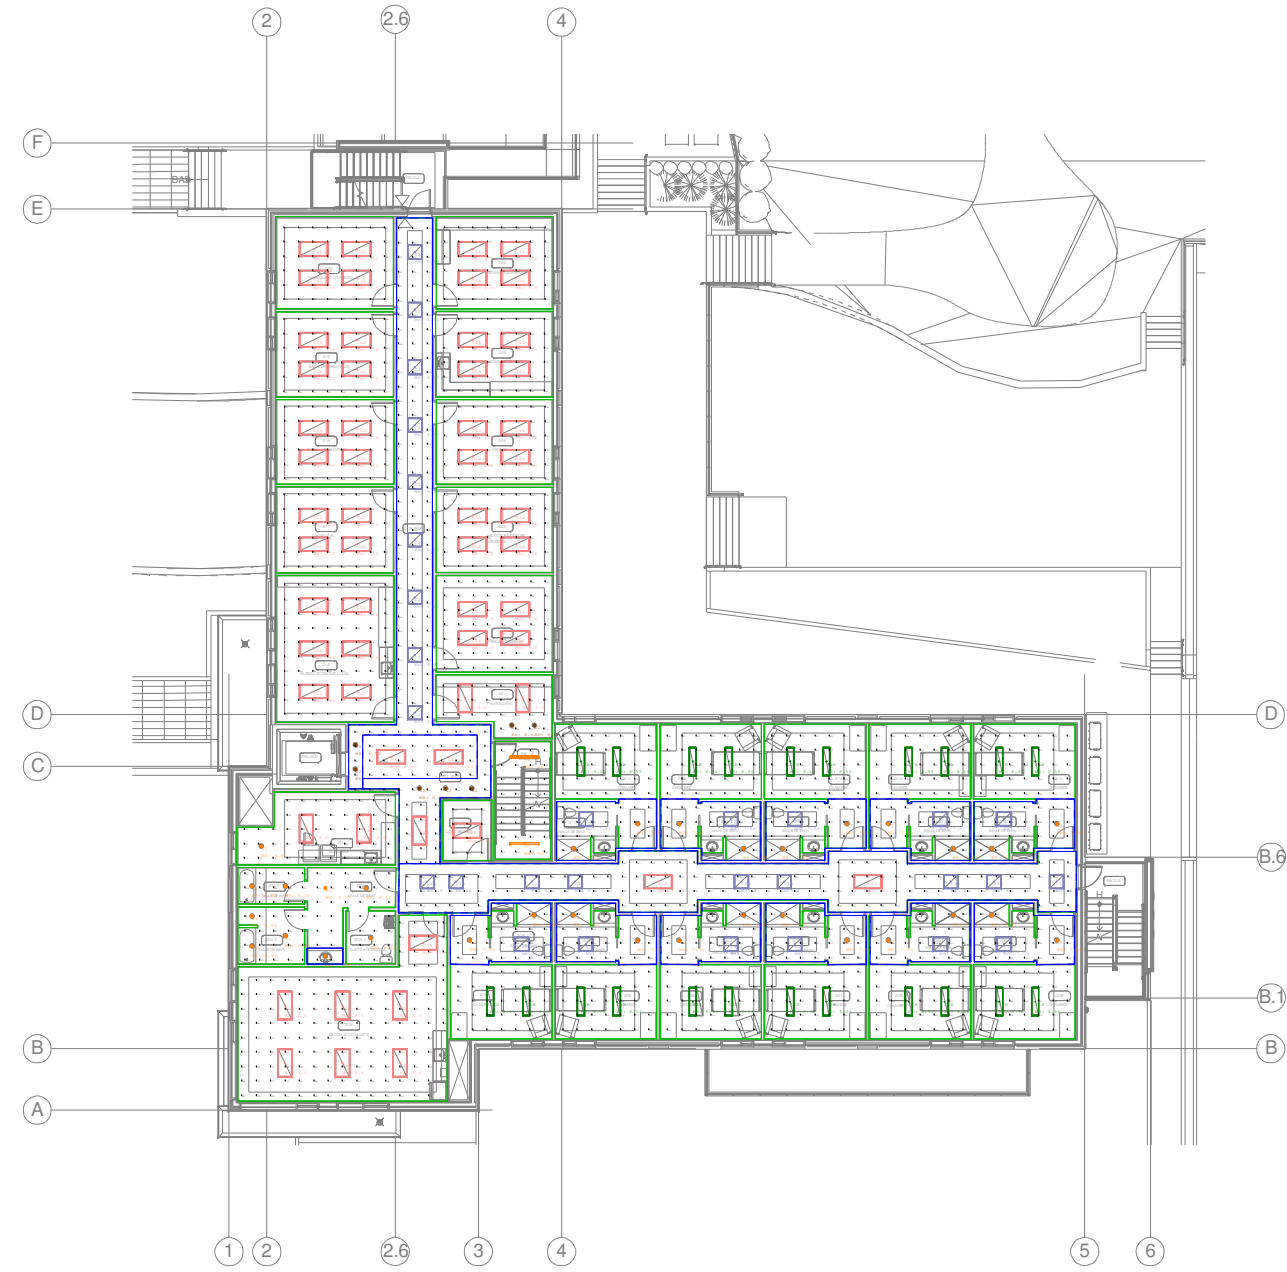



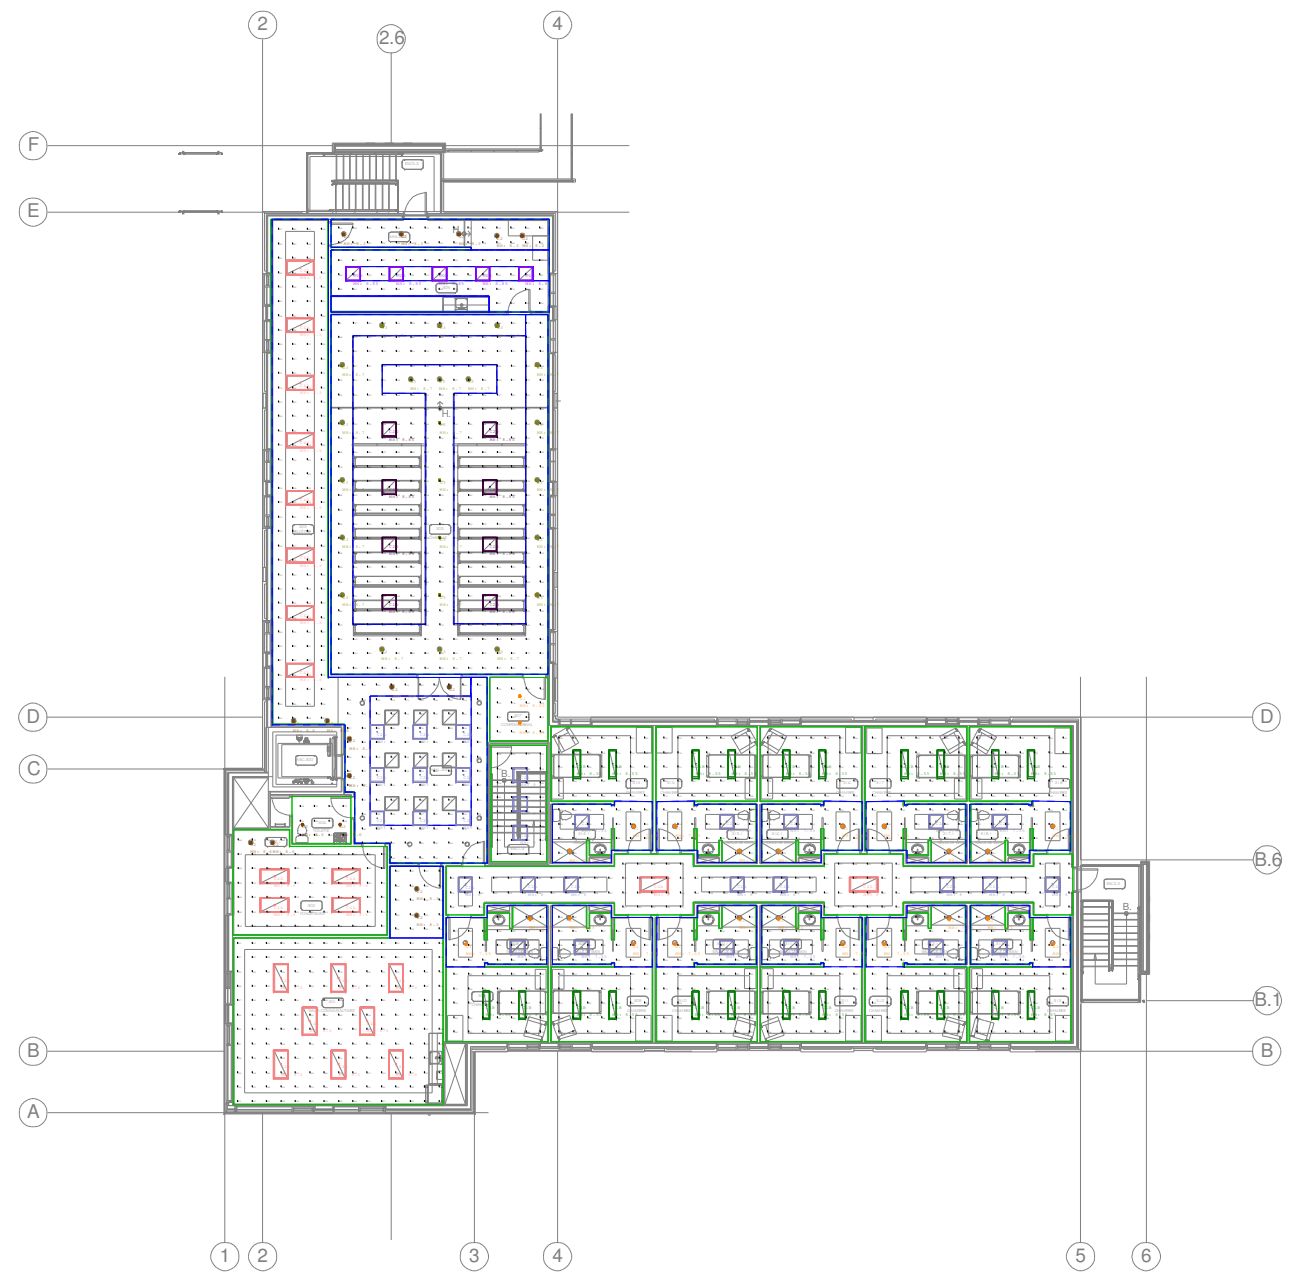










NIVEAU 2



NIVEAU 3

Réfectances: 80/50/20

Luminaire Schedule							
Symbol	Qty	Label	Arrangement	LLF	Description	Lum. Lumens	Lum. Watts
	8	A1	Single	0.900	CSS L48 ALO3 (4000) MVOLT SWW3 (30) 80CRI + HC36	4749	36.24
	2	A2	Single	0.900	CSS L48 ALO3 (5000) MVOLT SWW3 (30) 80CRI + HC36	5457	43.3172
	10	B1	Single	0.900	CSS L48 ALO3 (4000) MVOLT MIN1 ZT SWW3 (30) 80CRI NLTAIR2 APDT	4749	36.24
	52	C1B	Single	0.900	CPX 1X4 3000LM 80CRI 30K SWL MIN10 ZT MVOLT	3227	24.84
	129	C2A	Single	0.900	CPX 2X2 2000LM 80CRI 30K SWL MIN10 ZT MVOLT	2093	15.6
	8	C2B	Single	0.900	CPX 2X2 3200LM 80CRI 30K SWL MIN10 ZT MVOLT	3432	27.66
	8	C2D	Single	0.900	CPX 2X2 5000LM 80CRI 30K SWL MIN10 ZT MVOLT	5187	41.8
	185	C4A	Single	0.900	CPX 2X4 3000LM 80CRI 30K SWL MIN10 ZT MVOLT	3207	24.57
	36	C4B	Single	0.900	CPX 2X4 4000LM 80CRI 30K SWL MIN10 ZT MVOLT	4755	35.94
	2	C4C	Single	0.900	CPX 2X4 ALO8 (High) 80CRI SWW7 (30) SWL MVOLT	6033	47.85
	77	D1	Single	0.900	INSPIRA 3-RD-L1000-12W-930-60D	994	12
	37	D2	Single	0.900	INSPIRA 3-RD-GMBL-L1000-12W-930-60D	1045	12
	23	D3	Single	0.900	INSPIRA 3-RD-GMBL-L1200-14W-930-60D	1200	14


Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
000 - CORRIDOR_Floor	Illuminance	Lux	215.02	287	81	2.65	3.54	0
002 - SALLE MULTIMEDIA_Workplane	Illuminance	Lux	616.03	764	314	1.96	2.43	2.5
003 - CHAMBRE MUSEE_Workplane	Illuminance	Lux	407.12	538	224	1.82	2.40	2.5
004 - BIBLIOTHEQUE_Workplane	Illuminance	Lux	388.81	537	161	2.41	3.34	2.5
005 - RANGEMENT_Workplane	Illuminance	Lux	364.12	459	203	1.79	2.26	2.5
006 - TOILETTE H_Workplane	Illuminance	Lux	296.02	603	130	2.28	4.64	2.5
007 - TOILETTE_Workplane	Illuminance	Lux	233.75	369	61	3.83	6.05	2.5
008 - TOILETTE F_Workplane	Illuminance	Lux	284.20	602	129	2.20	4.67	2.5
009 - SALLE MEC_Workplane	Illuminance	Lux	334.63	526	186	1.80	2.83	2.5
010 - CONCIERGERIE_Workplane	Illuminance	Lux	335.83	517	179	1.88	2.89	2.5
011 - SALLE MEC_Workplane	Illuminance	Lux	493.34	718	116	4.25	6.19	2.5
012 - BUANDERIE_Workplane	Illuminance	Lux	439.09	561	233	1.88	2.41	2.5
013 - ARCHIVES_Workplane	Illuminance	Lux	409.20	536	223	1.83	2.40	2.5
014 - GDMA_Workplane	Illuminance	Lux	338.80	448	204	1.66	2.20	2.5
015 - EDITION DU CENACLE_Workplane	Illuminance	Lux	477.65	596	284	1.68	2.10	2.5
016 - SALLE A MANGER_Workplane	Illuminance	Lux	444.55	551	223	1.99	2.47	2.5
017 - VESTIAIRES RELIGIEUSES_Workplane	Illuminance	Lux	333.22	444	196	1.70	2.27	2.5
018 - VESTIAIRE RELIGIEUSES_Workplane	Illuminance	Lux	332.80	443	187	1.78	2.37	2.5
019 - ARCHIVES_Workplane	Illuminance	Lux	390.59	495	211	1.85	2.35	2.5
020 - ARCHIVES_Workplane	Illuminance	Lux	337.38	448	200	1.69	2.24	2.5
021 - ATELIER BUREAU_Workplane	Illuminance	Lux	609.27	756	326	1.87	2.32	2.5
100 - CORRIDOR	Illuminance	Lux	354.56	647	182	1.95	3.55	0
100 - HALL_Floor	Illuminance	Lux	254.25	292	219	1.16	1.33	0
100 - VESTIBULE_Floor	Illuminance	Lux	258.08	302	209	1.23	1.44	0
101 - CORRIDOR	Illuminance	Lux	226.62	347	127	1.78	2.73	0
101 - RECEPTION	Illuminance	Lux	523.42	786	245	2.14	3.21	0
102 - VESTIAIRE	Illuminance	Lux	284.38	340	210	1.35	1.62	0
103 - PARLOIR_Workplane	Illuminance	Lux	332.72	372	260	1.28	1.43	2.5
104 - PARLOIR_Workplane	Illuminance	Lux	303.09	421	193	1.57	2.18	2.5
105A - VESTIAIRE_Workplane	Illuminance	Lux	286.82	396	140	2.05	2.83	2.5

Réfectances: 80/50/20


Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
105B - VESTIAIRE	Illuminance	Lux	212.81	290	165	1.29	1.76	0
106 - PARLOIR_Workplane	Illuminance	Lux	340.87	460	191	1.78	2.41	2.5
107 - APOSTOLAT_Workplane	Illuminance	Lux	378.87	501	149	2.54	3.36	2.5
108 - APOSTOLATE_Workplane	Illuminance	Lux	377.62	493	149	2.53	3.31	2.5
109 - CHAMBRE_Workplane	Illuminance	Lux	300.60	608	97	3.10	6.27	2.5
110 - CHAMBRE_Workplane	Illuminance	Lux	299.75	639	88	3.41	7.26	2.5
111A - REPROGRAPHIE	Illuminance	Lux	316.57	516	181	1.75	2.85	0
111B - REPROGRAPHIE	Illuminance	Lux	510.65	639	354	1.44	1.81	0
112 - SALLE DE REUNION_Workplane	Illuminance	Lux	555.19	725	312	1.78	2.32	2.5
113 - BUREAU FINANCES_Workplane	Illuminance	Lux	509.45	749	286	1.78	2.62	2.5
115 - CHAMBRE_Workplane	Illuminance	Lux	299.83	571	100	3.00	5.71	2.5
116 - CHAMBRE_Workplane	Illuminance	Lux	299.02	592	93	3.22	6.37	2.5
117 - TOILETTES MIXTES_Workplane	Illuminance	Lux	308.75	711	105	2.94	6.77	2.5
118 - TOILETTE_Workplane	Illuminance	Lux	258.50	329	198	1.31	1.66	2.5
119 - CONCIERGERIE_Workplane	Illuminance	Lux	324.75	460	227	1.43	2.03	2.5
120 - AIRE DE SERVICE	Illuminance	Lux	405.32	557	144	2.81	3.87	2.5
121 - REFECTOIRE	Illuminance	Lux	433.53	529	252	1.72	2.10	2.5
122 - SALLE A MANGER_Workplane	Illuminance	Lux	245.40	304	157	1.56	1.94	2.5
123 - CUISINE_Workplane	Illuminance	Lux	418.98	577	179	2.34	3.22	2.5
201 - BUANDERIE_Workplane	Illuminance	Lux	268.55	414	125	2.15	3.31	2.5
201 - CORRIDOR	Illuminance	Lux	224.97	514	114	1.97	4.51	0
202 - CORRIDOR	Illuminance	Lux	264.37	614	125	2.11	4.91	0
202 - SALLE DE BAIN_Workplane	Illuminance	Lux	244.67	511	69	3.55	7.41	2.5
203 - SALON ET CUISINETTE_Workplane	Illuminance	Lux	319.66	462	116	2.76	3.98	2.5
204 - CHAMBRE_Workplane	Illuminance	Lux	305.12	628	100	3.05	6.28	2.5
205 - CHAMBRE_Workplane	Illuminance	Lux	304.63	649	102	2.99	6.36	2.5
207-1 - CHAMBRE_Workplane	Illuminance	Lux	304.69	650	100	3.05	6.50	2.5
208 - CHAMBRE_Workplane	Illuminance	Lux	305.17	615	101	3.02	6.09	2.5
209-1 - CHAMBRE_Workplane	Illuminance	Lux	304.03	650	100	3.04	6.50	2.5
210 - CONCIERGERIE_Workplane	Illuminance	Lux	277.00	341	229	1.21	1.49	2.5
211 - CHAMBRE_Workplane	Illuminance	Lux	307.90	629	102	3.02	6.17	2.5
212 - CHAMBRE_1_Workplane	Illuminance	Lux	306.93	625	103	2.98	6.07	2.5
212 - CHAMBRE_Workplane	Illuminance	Lux	309.80	609	102	3.04	5.97	2.5
213 - CHAMBRE_Workplane	Illuminance	Lux	307.73	629	100	3.08	6.29	2.5
214 - CHAMBRE_Workplane	Illuminance	Lux	308.03	600	100	3.08	6.00	2.5

Réfectances: 80/50/20




Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z
215 - CHAMBRE_Workplane	Illuminance	Lux	307.24	630	100	3.07	6.30	2.5
216 - BUREAU ECONOMIE_Workplane	Illuminance	Lux	464.25	654	239	1.94	2.74	2.5
217 - CAUSE MJR_Workplane	Illuminance	Lux	471.48	690	259	1.82	2.66	2.5
218 - BUREAU_Workplane	Illuminance	Lux	473.21	694	259	1.83	2.68	2.5
219 - SALLE DE FORMATION_Workplane	Illuminance	Lux	473.10	693	259	1.83	2.68	2.5
220 - MUSIQUE ET LITHURGIE_Workplane	Illuminance	Lux	464.56	685	251	1.85	2.73	2.5
221 - PHOTOCOPIE_Workplane	Illuminance	Lux	430.64	780	251	1.72	3.11	2.5
222 - PRIEURE GENERAL_Workplane	Illuminance	Lux	432.98	691	215	2.01	3.21	2.5
223 - SECRETAIRE PRIEURE_Workplane	Illuminance	Lux	473.88	693	258	1.84	2.69	2.5
224 - PRIEURE_Workplane	Illuminance	Lux	474.67	693	259	1.83	2.68	2.5
225 - SOINS INFIRMIERS_Workplane	Illuminance	Lux	472.73	691	261	1.81	2.65	2.5
226 - SOINS PODIATRIQUES_Workplane	Illuminance	Lux	464.50	685	251	1.85	2.73	2.5
300 - HALL	Illuminance	Lux	345.20	498	128	2.70	3.89	0
301 - CORRIDOR_Floor	Illuminance	Lux	203.83	257	115	1.77	2.23	0
301 - SALLE COMMUNAUTAIRE_Workplane	Illuminance	Lux	327.17	555	81	4.04	6.85	2.5
302 - FONDATEURS_Workplane	Illuminance	Lux	408.26	721	192	2.13	3.76	2.5
302 - SAS	Illuminance	Lux	306.20	593	161	1.90	3.68	0
303 - CHAPELLE_Workplane	Illuminance	Lux	449.61	753	74	6.08	10.18	2.5
303 - CLOITRE	Illuminance	Lux	278.08	406	127	2.19	3.20	0
305 - SACRISTIE	Illuminance	Lux	468.18	567	254	1.84	2.23	2.5
306 - TOILETTE_Workplane	Illuminance	Lux	292.08	401	170	1.72	2.36	2.5
307 - CONFESSIIONNAL_Workplane	Illuminance	Lux	252.63	443	102	2.48	4.34	2.5
308 - CHAMBRE_Workplane	Illuminance	Lux	305.98	622	97	3.15	6.41	2.5
309 - CHAMBRE_Workplane	Illuminance	Lux	305.27	641	99	3.08	6.47	2.5
310 - CHAMBRE_Workplane	Illuminance	Lux	306.27	618	98	3.13	6.31	2.5
311 - CHAMBRE_Workplane	Illuminance	Lux	305.61	641	96	3.18	6.68	2.5
312 - CHAMBRE_Workplane	Illuminance	Lux	306.19	608	97	3.16	6.27	2.5
313 - CHAMBRE_Workplane	Illuminance	Lux	304.98	641	96	3.18	6.68	2.5
314 - CHAMBRE_Workplane	Illuminance	Lux	307.71	631	102	3.02	6.19	2.5
315 - CHAMBRE_Workplane	Illuminance	Lux	307.97	602	101	3.05	5.96	2.5
316 - CHAMBRE_Workplane	Illuminance	Lux	307.93	632	100	3.08	6.32	2.5
317 - CHAMBRE_Workplane	Illuminance	Lux	308.17	600	100	3.08	6.00	2.5
318 - CHAMBRE_Workplane	Illuminance	Lux	307.27	631	100	3.07	6.31	2.5
ESC1 - 0_Floor	Illuminance	Lux	258.59	282	232	1.11	1.22	0
ESC1 - 1_Floor	Illuminance	Lux	260.81	285	233	1.12	1.22	0
ESC1 - 2_Floor	Illuminance	Lux	260.59	285	233	1.12	1.22	0
ESC1 - 3_Floor	Illuminance	Lux	214.94	271	153	1.40	1.77	0
ESC2-0_Floor	Illuminance	Lux	231.78	260	204	1.14	1.27	0
ESC3-0_Floor	Illuminance	Lux	240.14	267	217	1.11	1.23	0
ESC3_Floor	Illuminance	Lux	364.14	646	172	2.12	3.76	0

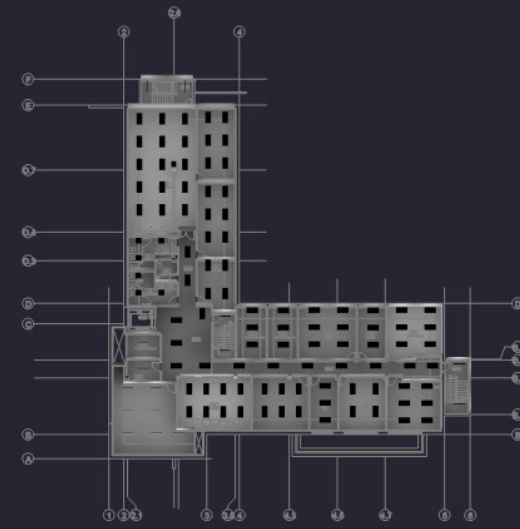


NIVEAU 0

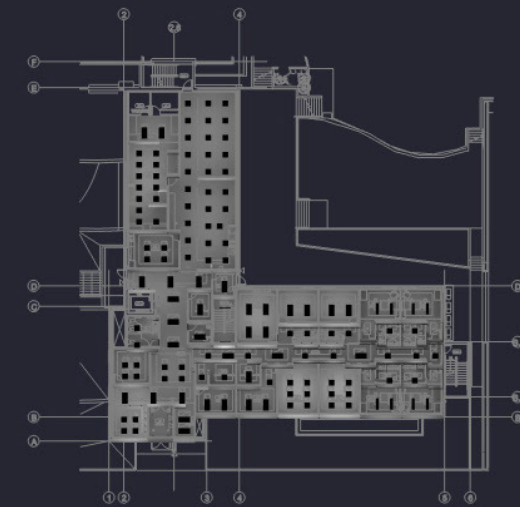


NIVEAU 1

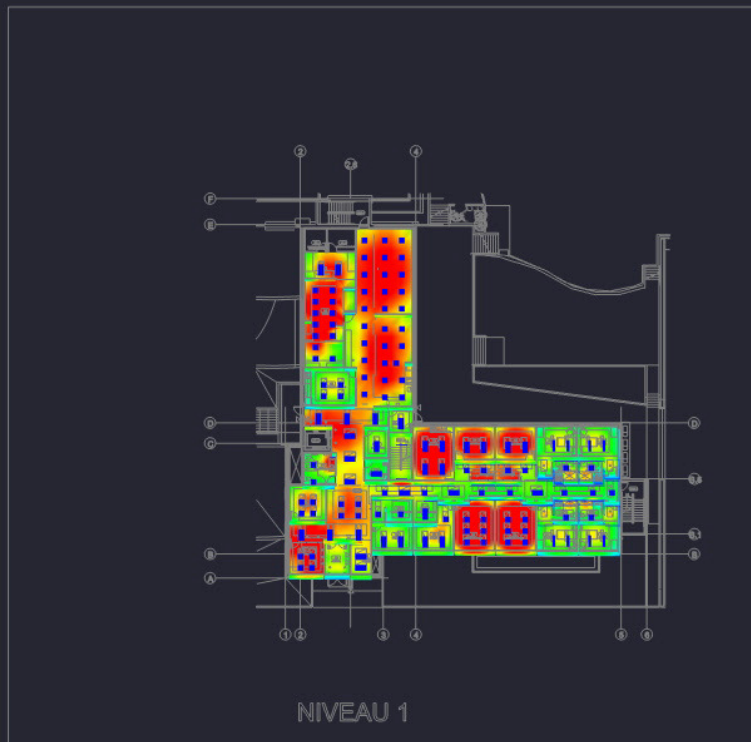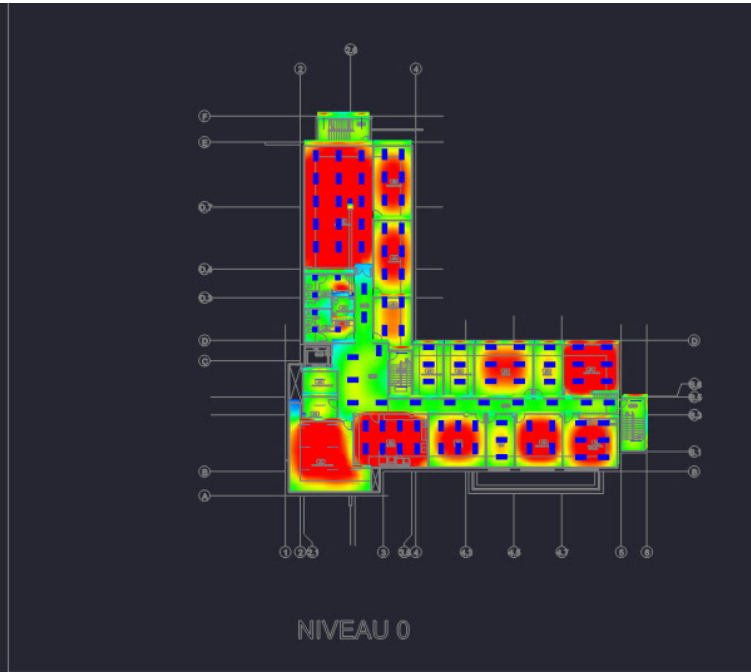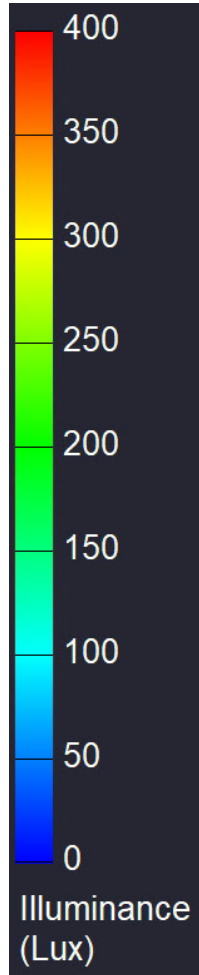

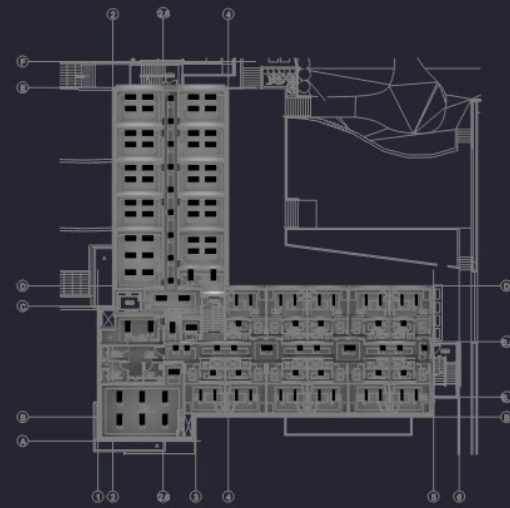

NIVEAU 2

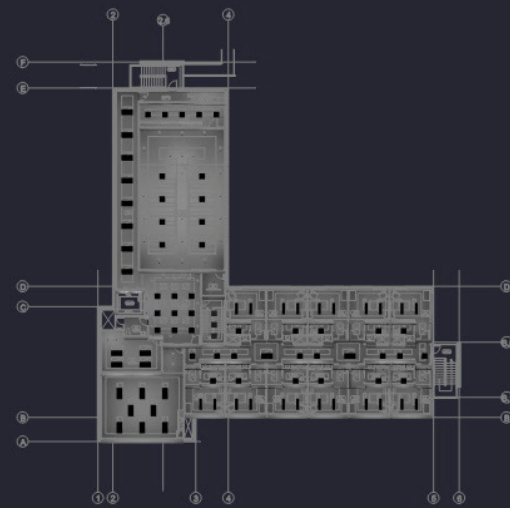

NIVEAU 3

